

**EXHIBIT 4 SHEET 2
MOHAVE SWITCHYARD**

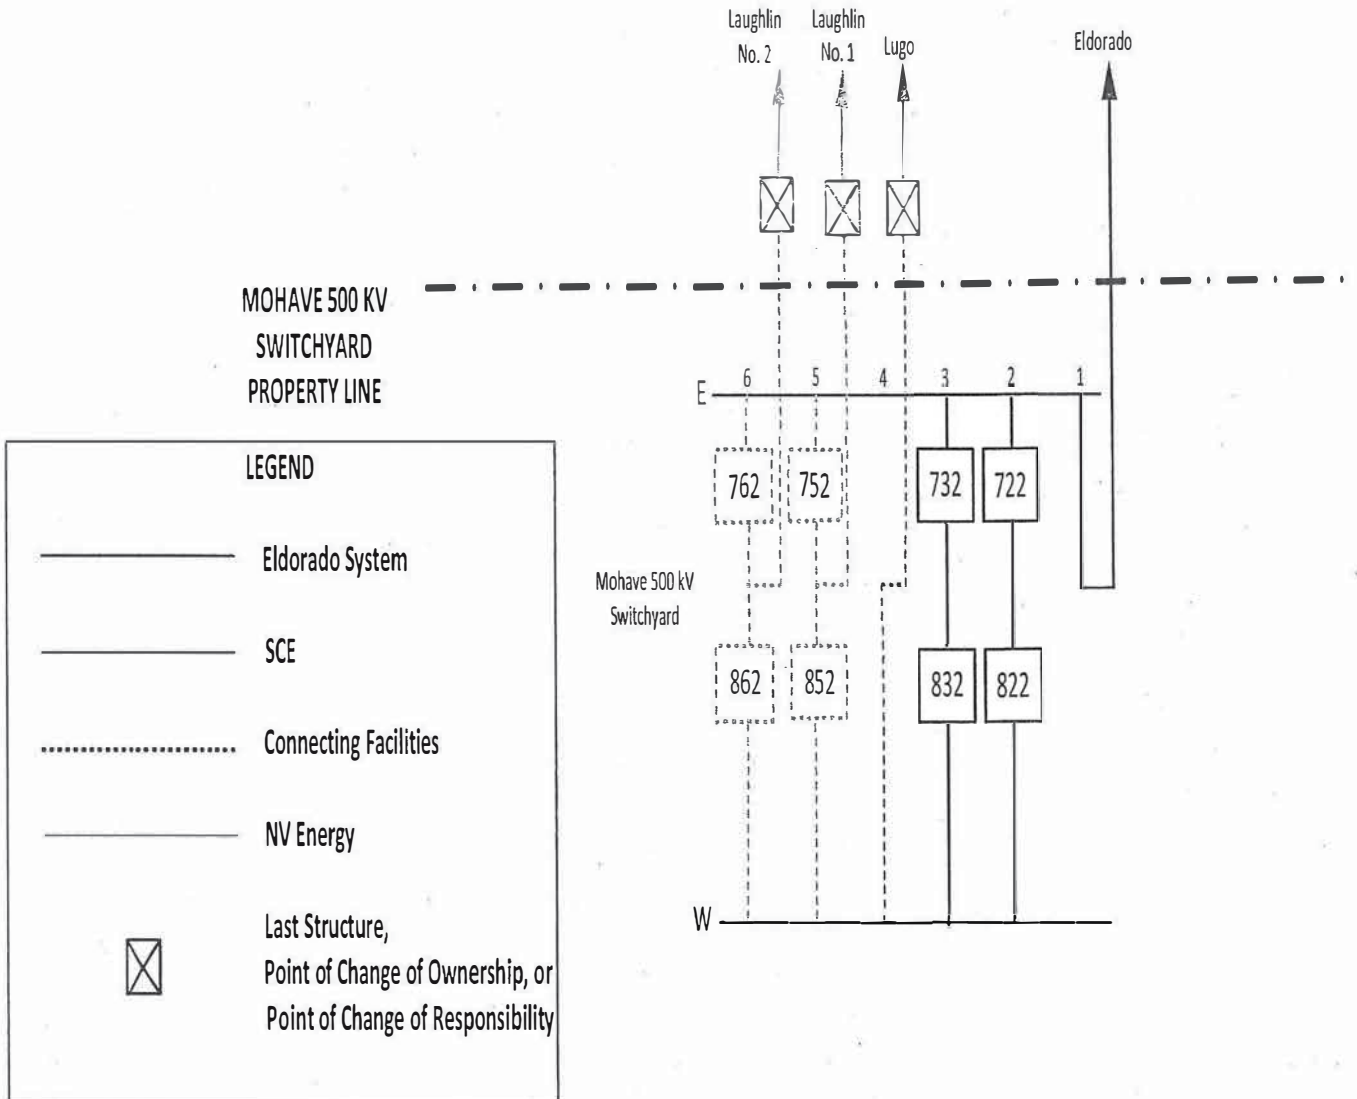


EXHIBIT 5 CONNECTING FACILITIES

EXHIBIT 5A

CONNECTING FACILITIES SOLELY OWNED BY A CO-OWNER

1. Mohave Switchyard
 - 1.1. the Laughlin-Mohave No. 1 and No. 2 500 kV transmission lines to the Mohave Switchyard, including circuit breakers, disconnect switches, and associated equipment.
 - 1.1.1. Ownership shares: NV Energy 100%
 - 1.2. the Lugo-Mohave 500 kV transmission line to the Mohave 500 kV Switchyard, including transmission structures, series capacitors, line reactors, circuit breakers, disconnect switches, and associated equipment.
 - 1.2.1. Ownership Shares: SCE 100%
2. Eldorado 220 kV Switchyard
 - 2.1. the Eldorado-Magnolia 230 kV transmission line to the Eldorado 220 kV Switchyard, including transmission structures, circuit breakers, disconnect switches, and associated equipment.
 - 2.1.1. Ownership shares: NV Energy 100%
 - 2.2. the Eldorado-NSO 230 kV transmission line to the Eldorado 220 kV Switchyard, including transmission structures, circuit breakers, disconnect switches, and associated equipment.
 - 2.2.1. Ownership shares: NV Energy 100%
 - 2.3. the Cima-Eldorado-Pisgah No. 1 and No. 2 220 kV transmission lines to the Eldorado 220 kV Switchyard including transmission structures, circuit breakers, disconnect switches, and associated equipment.
 - 2.3.1. Ownership shares: SCE 100%
 - 2.4. the Eldorado-Merchant No. 1 230 kV transmission line to the Eldorado 220 kV Switchyard, including circuit breakers, disconnect switches, conductors and associated equipment.
 - 2.4.1. Ownership shares: SCE 100%

- 2.5. the Eldorado-Merchant No. 2 230 kV transmission line to the Eldorado 220 kV Switchyard, including circuit breakers, disconnect switches, conductors and associated equipment.
 - 2.5.1. Ownership shares NV Energy 100%
3. Eldorado 500 kV Switchyard
 - 3.1. the Eldorado-McCullough 500 kV transmission line including transmission structures, circuit breakers, disconnect switches, and associated equipment.
 - 3.1.1. Ownership shares: LADWP 100%
 - 3.2. the Eldorado-Lugo 500 kV transmission line including transmission structures, circuit breakers, disconnect switches, series capacitors, line reactors, and associated equipment.
 - 3.2.1. Ownership Shares: SCE 100%
 - 3.3. the Eldorado-Moenkopi 500 kV transmission line including transmission structures, circuit breakers, disconnect switches, series capacitors, line reactors, and associated equipment.
 - 3.3.1. Ownership Shares: SCE 100%
 - 3.4. the Connecting Facilities for the Eldorado 5AA Bank, including circuit breakers, disconnect switches, and associated equipment.
 - 3.4.1. Ownership shares: SCE 100%

EXHIBIT 5B

CONNECTING FACILITIES JOINTLY OWNED BY THE CO-OWNERS

(Reserved)

EXHIBIT 6
CAPACITY ENTITLEMENTS IN
COMPONENTS OF THE ELDORADO SYSTEM (MW)

Component	LADWP	NV Energy	SCE
Eldorado-Mohave Line	716	334	530
Eldorado-Mead Lines	215	301	624
Eldorado 500/220 kV Transformers	159	222	669

Calculation of Capacity Entitlements:

Eldorado-Mohave Line:

Capacity = 1580 MW

Capacity Entitlements:

$$\text{LADWP} = 45.300\% \times 1580 \text{ MW} = 716 \text{ MW}$$

$$\text{NV Energy} = 21.140\% \times 1580 \text{ MW} = 334 \text{ MW}$$

$$\text{SCE} = 33.560\% \times 1580 \text{ MW} = 530 \text{ MW}$$

Eldorado-Mead Lines:

Capacity = 1140 MW

Capacity Entitlements:

$$\text{LADWP} = 18.875\% \times 1140 \text{ MW} = 215 \text{ MW}$$

$$\text{NV Energy} = 26.425\% \times 1140 \text{ MW} = 301 \text{ MW}$$

$$\text{SCE} = 54.700\% \times 1140 \text{ MW} = 624 \text{ MW}$$

Eldorado 500/220 kV Transformers:

Capacity = 1050 MW

Capacity Entitlements:

$$\text{LADWP} = 15.100\% \times 1050 \text{ MW} = 159 \text{ MW}$$

$$\text{NV Energy} = 21.140\% \times 1050 \text{ MW} = 222 \text{ MW}$$

$$\text{SCE} = 63.760\% \times 1050 \text{ MW} = 669 \text{ MW}$$